

“
By replacing outdated equipment and utilizing John Henry Foster’s technology expertise, we have enjoyed a 40% reduction in energy costs.

JHF’s compressed air audit, along with power factor data comparisons between old equipment and new, was instrumental in our decision to replace our existing equipment. LSI will realize its R.O.I. in less than 13 months through energy savings and rebates.

Dave Eberhardt
Director of Manufacturing
LSI Corporation of America
Minneapolis, Minn.



Dustin Nord

Ryan Koepsell

Meet our Team of Experts

Ryan L. Koepsell, B.S.M.E.

Ryan holds a B.S. degree in Mechanical Engineering from the University of Minnesota, Duluth and has completed training designed by the U.S. Department of Energy and Compressed Air Challenge and is a certified AIRMaster+ Specialist.

Direct 651.681.5756

888.681.5756

Cell 651.341.1040

Fax 651.905.2885

ryan.koepsell@jhfooster.com

jhfooster.com

Dustin Nord, B.S.I.T.

Dustin holds a B.S. degree in Industrial Technology from the University of North Dakota, Grand Forks and has completed training designed by the U.S. Department of Energy and Compressed Air Challenge.

Direct 651.994.7286

866.955.7286

Cell 651.341.1026

Fax 651.905.2885

dustin.nord@jhfooster.com

jhfooster.com




For more than 70 years, John Henry Foster (www.jhfooster.com) has been the Midwest’s leading air compressor systems distributor and service provider, bringing our clients customized solutions in consistency, reliability and profitability. To learn more about Compressed Air Efficiency Audits, as well as the latest trends in world-class compressed air automation, air compressors and electrical motion controls, contact JHF and has for our audit department at 651.452.8452.

COMPRESSED AIR ENERGY EFFICIENCY PROGRAMS

Compressed air systems in industrial facilities represent the greatest opportunity for energy savings initiatives



**John
Henry
Foster**

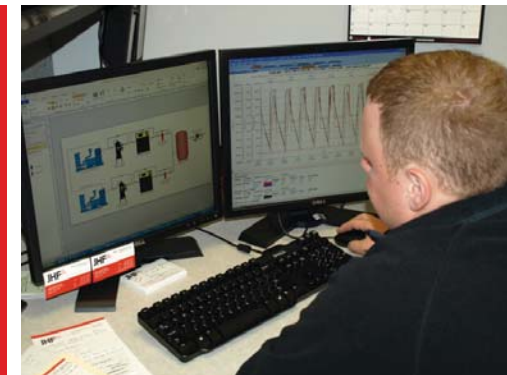

JHF John Henry Foster
800.582.5162
jhfooster.com

ENERGY AUDITS BRING BIG SAVINGS

70% of facilities utilize compressed air in some aspect - a compelling reason to investigate the potential for energy savings

As businesses are searching for new ways to save money, it's prudent to conduct an energy audit to examine how efficiently a compressed air system operates year after year. It's a fact: When businesses purchase equipment based on cost rather than efficiency, they will spend more on energy bills in the long run. More specifically, electricity used to run compressed air systems could be more than 75% of their system's total lifetime costs.

BENEFITS OF COMPRESSED AIR EFFICIENCY AUDITS

MAXIMIZE SYSTEM PERFORMANCE

A large copier toner producer, with over 5,000 h.p. of installed air compressor base, maximized system efficiency and performance with a centralized master control and monitor equipment designed by JHF. The automation of the compressed air system resulted in an operation cost reduction of \$200K, as well as associated maintenance costs.

LOWER OPERATIONAL COSTS

Systems Engineers from JHF, working with a large freezer manufacturer recommended improvements in the operation and design of their compressed air system which resulted in an annual operational cost savings of over \$100K. The recommendations to the compressed air system qualified for energy rebates from a local utility of \$166K, reducing project ROI to less than two years.

INCREASE SYSTEM RELIABILITY AND STABILITY

A metal finishing company, based on information from a compressed air system audit, justified the installation of additional compressed air equipment, which resulted in an increase in system reliability, stability and redundancy. System improvements eliminated unscheduled shutdowns, reduced operational and maintenance costs and provided back-up capability for production.

INCREASED PRODUCTIVITY

A precision manufacturing company, based on recommendations from a compressed air audit, installed storage tanks and demand regulation, which stabilized system pressure. The stabilizing of system pressure resulted in a dramatic increase in product throughput without increased operational costs.

ELIMINATE INAPPROPRIATE AIR USAGE


Results of a compressed air audit at a manufacturing plant identified multiple blow-off applications utilizing high pressure air from the plant compressed air system. Low pressure blowers were recommended and installed which not only reduced plant air demand but also a reduction in operational costs.

“
Following a compressed air audit on our 250,000-square-foot facility, John Henry Foster identified a plumbing project that allowed us to turn off a 50HP compressor and identify numerous air leaks. In just the first two months, we have already seen energy savings of over 30%! And we expect those savings to increase over time.

Pete Madsen
Maintenance Supervisor
Ryerson, Inc.
Plymouth, Minnesota

”

Typical Lifetime Compressed Air Costs

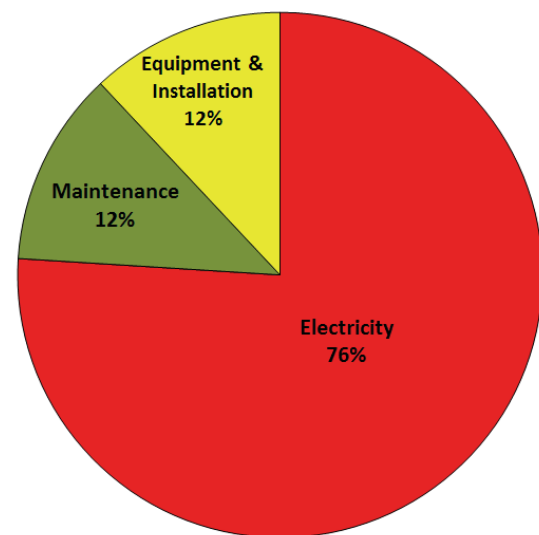

*Source US DOE, Office of Industrial Technologies: "Energy Tips"

JHF has conducted over **500 audits** resulting in energy savings exceeding **\$4M.**

INDUSTRIES SERVED

JHF uses state-of-the-art equipment to monitor systems ranging from 25 to over 1,000 horsepower. We customize our audits for companies of all sizes – small, medium or large – in numerous industries, including:

- Agricultural • Automation • Energy • Industrial • Medical • Technology • Transportation

BUSINESSES CAN RECEIVE AN AVERAGE OF \$10,000 IN ENERGY REBATES

JHF partners with energy companies to identify savings initiatives. Federal and state programs are available to assist you in achieving significant energy and process efficiencies.

- Xcel Energy
- Alliant Energy
- Otter Tail Power Company
- Wisconsin Focus on Energy
- Dakota Electric
- Missouri River Energy
- Minnesota Power

EXPERIENCE THE DIFFERENCE

JHF's audits offer an in-depth, comprehensive look at the operation of an entire compressed air system. We utilize advanced software to establish a baseline that addresses the "what if" scenarios for system improvements. Our audits provide the most detailed and accurate analysis and information available, including:

- State-of-the-art equipment monitors kW, amps, pressure, flow and dew point.
- Breakdown of flow usage
- Supply equipment assessment
- Distribution system assessment
- Point-of-use assessment
- System upgrade recommendations
- Return on investment applied to all recommendations
- Supporting data (Real-time monitoring graphs)

